





## GAS TRANSMITTER

### AT/ET/UT/CT/OT-3X1 USER MANUAL



www.emskontrol.com



#### WHAT IS IT?

Gas transmitter accurately measures the gas value in the environment and provides an analog output.

#### HOW DOES IT WORK?

It can operate with a supply between 12 V DC and 24 V DC. Measurement values are taken from the analog output terminals and transferred to the desired location.

#### GENERAL FEATURES

Accurate and Precise Measuring, Analog Output, Durable and Handy Design, Long Operating Life, Easy Mounting, IP 67 Enclosure (Excluding Sensor)


#### AREAS OF USE

HVAC Applications, Poultry Automation and Poultry Farms, Cold Storage, Incubation Rooms, Food Storage, Air Conditioning Cabinets, Clean Rooms and Laboratories.

#### SAFETY PRECAUTIONS

- 1- Always read the user manual before using the device and its apparatus.
- 2- Damages caused by opening, breaking or misuse of the plastic parts of the device and its apparatus are considered out of warranty.
- 3- Keep the device and its apparatus away from external influences such as liquid, high dust, high temperature, etc. and protect them.
- 4- Do not expose the device cables to crushing, pinching, or excessive pressure.
- 5- Disconnect the electrical power when your device is not used for a long time.
- 6- Our devices and apparatus should be used by paying attention to the points in the user manual. In case of damages and malfunctions arising from external use (liquid contact, dropping the device, etc.) ask for help from the service.
- 7- Failures due to electrical connection errors and electrical voltage or current errors are not covered by the warranty

| P. Code | Output Signal           |
|---------|-------------------------|
| XT-301  | 0-10 V / 2-10 V / 0-3 V |
| XT-341  | 4-20 mA / 0-20 mA       |
| XT-361  | Modbus RTU              |

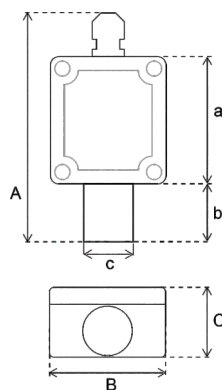


| Sizes |        |
|-------|--------|
| A     | 110 mm |
| B     | 58 mm  |
| C     | 35 mm  |
| a     | 64 mm  |
| b     | 24 mm  |
| c     | 24 mm  |

#### Technical Data

|                                                |                                                            |
|------------------------------------------------|------------------------------------------------------------|
| Product Name:                                  | Gas Transmitter                                            |
| Supply Voltage:                                | 12-24 V DC                                                 |
| Output:                                        | 0-10 V / 2-10 V / 0-3 V<br>4-20 mA / 0-20 mA<br>Modbus RTU |
| Output Range (NH <sub>3</sub> ):               | 0-100 ppm                                                  |
| Sensitivity (NH <sub>3</sub> ):                | ± 1 ppm                                                    |
| Accuracy (NH <sub>3</sub> ):                   | ± 2 ppm                                                    |
| Output Range (C <sub>2</sub> H <sub>4</sub> ): | 0-10 ppm / 0-100 ppm                                       |
| Sensitivity (C <sub>2</sub> H <sub>4</sub> ):  | ± 0,1 ppm                                                  |
| Accuracy (C <sub>2</sub> H <sub>4</sub> ):     | ± 1 ppm                                                    |
| Output Range (SO <sub>2</sub> ):               | 0-100 ppm / 0-200 ppm                                      |
| Sensitivity (SO <sub>2</sub> ):                | ± 0,1 ppm                                                  |
| Accuracy (SO <sub>2</sub> ):                   | ± 1 ppm                                                    |
| Output Range (CO):                             | 0-1.000 ppm                                                |
| Sensitivity (CO):                              | ± 1 ppm                                                    |
| Accuracy(CO):                                  | ± 5 ppm                                                    |
| Output Range (O <sub>2</sub> ):                | 0-25 % vol                                                 |
| Sensitivity (O <sub>2</sub> ):                 | ± 0,1 % vol                                                |
| Accuracy (O <sub>2</sub> ):                    | ± 1 % vol                                                  |
| Operating Temperature:                         | -10°C...+55°C                                              |
| Storage Temperature:                           | -20°C...+60°C                                              |
| Protection Class:                              | IP 67 (Excluding Sensor)                                   |

#### INSTALLATION

- 1- Unpack the product and remove the top cover.
- 2- Make cable connections according to wiring diagram.

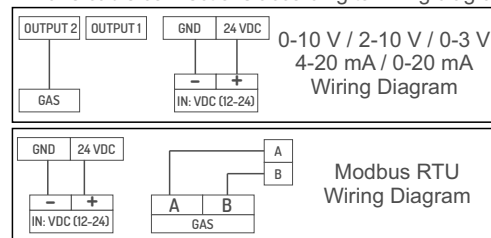

- 3- If the product will be mounted on the wall, you can use the screws and dowels in the package.
- 4- The device starts measuring approximately 30 seconds after power is applied. It is recommended that the product remains in the environment for at least 5 minutes to obtain accurate measurement values.
- 5- It is recommended to use shielded cable as communication cable as it will prevent communication signals from being affected by external influences.
- 6- Because cable resistance may affect the measurements, check the measurement values again after installation.

#### MODBUS RTU COMMUNICATION STRUCTURE

RS485 Baud rate value in Modbus communication is 9600 by default. Stop bit: 1, Parity: NONE. Default Slave ID is 85. Gas value is kept in the holding register at address 2 (40003). Gas information can be obtained by reading these registers.

Register map and default values table:

| Register       | Address   | Default Value | Read Write | Min. Value | Max. Value |
|----------------|-----------|---------------|------------|------------|------------|
| Slave ID       | 0 (40001) | 85            | R/W        | 1          | 247        |
| Baud rate      | 1 (40002) | 3             | R/W        | 0          | 8          |
| Gas Value      | 2 (40003) | -             | R          | -          | -          |
| Velocity Stage | 3 (40004) | 4             | R/W        | 1          | 5          |

Slave ID and Baud rate can be changed via Modbus communication. For this, the desired Slave ID is written to the register with address 0 (40001), which is the register where the Slave ID is located. Likewise, if the Baud rate is to be changed, the Baud rate can be changed by writing the value for the desired Baud rate according to the table below in the register with address 1 (40002). If the velocity stage needs to be changed by writing the desired value to the address 3 (40004) register according to the table below.

| Value | Baud Rate | Value | Velocity Stage |
|-------|-----------|-------|----------------|
| 0     | 1200      | 1     | Very Fast      |
| 1     | 2400      | 2     | Fast           |
| 2     | 4800      | 3     | Normal         |
| 3     | 9600      | 4     | Slow           |
| 4     | 14400     | 5     | Very Slow      |
| 5     | 19200     |       |                |
| 6     | 38400     |       |                |
| 7     | 57600     |       |                |
| 8     | 115200    |       |                |

Press and hold the "Calibration" button to reset the changes made to the Slave ID, baud rate and velocity stage to the default values. Wait until the Status (green) LED turns off (approx. 30 seconds). After the LED turns off, the button is released. Thus, Slave ID, baud rate and velocity stage are returned to their default values.

#### LED Meanings

| Power (Red)    | On  | Normal Operating        |
|----------------|-----|-------------------------|
|                | Off | No Energy (Error)       |
| Status (Green) | On  | Measurement Preparation |
|                | On  | Normal Measurement      |
|                | Off | Error - Fault           |

#### BEFORE CALIBRATION

- 1- The product is supplied pre-calibrated. Please do not perform calibration unless necessary.
- 2- Perform calibration only if it has been confirmed that the product is measuring incorrectly.
- 3- Calibration can only be performed at the manufacturer's production facility. Please contact the manufacturer for calibration services.

#### SENSOR LIFETIME – KEY CRITERIA

- 1- The sensor has a service life of 2 years. After this period, the sensor must be replaced. Sensor replacement can be performed easily at the installation site.
- 2- Do not expose the sensor to high concentrations of natural gas. This may cause the sensor to malfunction.
- 3- Do not switch the sensor's power supply on and off frequently.

## USER MANUAL

### DECLARATION OF CONFORMITY

Headquarters and place of production, Mersinli Mah. 1201/2 Sk. Temsil Plaza No:2/F Konak / İZMİR - TÜRKİYE, EMS KONTROL ELEKTRONİK VE MAKİNE SAN. TİC. A.Ş. declares that the product marked with CE, whose name and specifications are given below, covers the specified directives and provisions.

Brand: Ems Kontrol  
Product Name: AT/ET/UT/CT/UT-3X1  
Product Type: Gas Transmitter

#### Compatible Directives:

Electromagnetic Compatibility Directive  
2014/30/EU (EMC EN 61000-6-3: 2007 + A1: 2011, EN 61000-6-1: 2007)

Low Voltage Directive  
2014/35/EU (LVD EN 60730-2-9:2010, EN 60730-1:2011)

Additional information: This product can be used in combination with other devices and compliance with the directives covers only the product. Ems Kontrol is not responsible for the compliance of the entire system with these directives.

This declaration is not valid if the product is modified without our approval.



**EMS KONTROL ELEKTRONİK  
VE MAKİNE SAN. TİC. A.Ş.**  
Mersinli Mahallesi, 1201/2 Sk. Temsil Plaza  
No:2/F Konak / İZMİR  
EGE V.D. 334 704 4628  
Mersis No: 0334104452800001

### WARRANTY TERMS

1- The warranty period of the device and accessories starts from the invoice date and is guaranteed for 2 years against manufacturing defects.

2- Device and accessories are delivered to the customer in working condition in our company. On-site commissioning is subject to service fee.

3- The repair of the device and accessories under warranty is carried out in our company as a result of sending them with the transportation company contracted by our company. In on-site services, transportation and accommodation expenses of the service personnel shall be borne by the customer. The cost of the working time spent on the road is added to the service fee and the collection is made in advance.

4- Maintenance of device and accessories is done in our company. Shipping and transportation costs of the device and accessories to and from our company for maintenance shall be borne by the customer

5- In case of malfunction of the device and accessories whose warranty period continues, whether the malfunction is caused by the fault of the customer or the manufacturer is tested in our company and reported with the report to be issued by our company.

6- In case of detection of manufacturer-induced faults of the device and accessories whose warranty period continues, the customer may request a replacement or may request that the repair costs of the device and accessories be fully covered by the manufacturer, provided that it does not exceed the product price.

7- In the event that the faults of the device and accessories whose warranty period continues are determined to be caused by the customer, all costs shall be borne by the customer.

8- If the customer does not indicate that he/she is aware of the defects in the device and accessories from the date the warranty period starts or in cases where he/she is expected to be aware, he/she cannot benefit from Article 6.

9- Failures arising from the use of device and accessories contrary to the points in the user manual are not covered by the warranty.

10- Device and accessories are not covered by the warranty if they are dropped, broken or scratched by the customer.

11- Damages caused by the use of device and accessories of other brands and models without the approval of the manufacturer are not covered by the warranty.

12- Errors caused by rusting, oxidation and liquid contact due to working in dusty / acidic / humid environments are not covered by the warranty.

13- Damages that may occur during transportation of device and accessories are not covered by the warranty. If the customer wishes, he/she can have transportation insurance.

14- Damages caused by mains voltage / faulty electrical installation are not covered by the warranty.

15- Device and accessories are not covered by the warranty in case of malfunctions caused by force majeure such as fire, flood, earthquake, etc.

16- All parts of the device and accessories, including all parts, are covered by our company's warranty.

17- If the device and accessories malfunction within the warranty period, the time spent in repair shall be added to the warranty period. The repair period of the goods shall not exceed 20 working days. This period starts from the date of notification of the malfunction of the goods to the service station, in the absence of a service station, to the seller, dealer, agent, representative, importer or manufacturer - manufacturer of the goods. It is possible for the consumer to notify the malfunction by telephone, fax, e-mail, registered letter with return receipt or similar means. However, in case of dispute, the burden of proof belongs to the consumer. If the malfunction of the goods is not resolved within 20 business days, the manufacturer-manufacturer or importer; until the repair of the goods is completed, another product with similar characteristics must be allocated to the use of the consumer.

18- Despite the consumer's right to repair the goods; -Provided that it is within the warranty period from the date of delivery to the consumer, it fails at least four times within a year or six times within the warranty period determined by the manufacturer-manufacturer and / or importer, as well as the fact that these failures make the inability to benefit from the goods continuous, -Exceeding the maximum time required for repair, -If it is determined that it is not possible to repair the malfunction with the report to be issued by the service station of the company's service station, if the service station is not available, respectively by one of its dealer, dealer, agency, representative, importer or manufacturer-manufacturer, it may request a refund or a price reduction at the rate of defect.

19- Customer may file complaints and objections to consumer courts or consumer arbitration committees.

20- The warranty certificate must be kept by the customer during the warranty period. In case of loss of the document, a second document will not be issued. In case of loss, repair and replacement of device and accessories will be made for a fee.



This device is a Waste Electrical and Electronic Device according to the directives applied in Europe 2002/96/EC. (WEEE) Before scrapping or throwing away this device, you must prevent its potential negative consequences for the environment and human health. Otherwise it would be inappropriate waste. This symbol on the product is intended to warn that the product should not be treated as household waste and should be delivered to electrical and electronic waste collection points. Disposal of the product must be done in accordance with local environmental regulations. You can obtain detailed information from authorized units on how to destroy, reuse and recycle the product.

#### Manufacturer's

Title: EMS KONTROL ELEKTRONİK VE MAKİNE SAN. VE TİC. A.Ş.

Address: Mersinli Mah. 1201/2 Sokak Temsil Plaza No:2/F Konak / İzmir-TÜRKİYE  
Telephone: 0 (232) 431 2121  
E-Mail: [info@emskontrol.com](mailto:info@emskontrol.com)

Company Stamp:

**STAMP**  
**EMS KONTROL ELEKTRONİK  
VE MAKİNE SAN. TİC. A.Ş.**  
Mersinli Mahallesi, 1201/2 Sk. Temsil Plaza  
No:2/F Konak / İZMİR  
EGE V.D. 334 704 4628  
Mersis No: 0334104452800001

#### Product's

Type: Gas Transmitter  
Brand: Ems Kontrol  
Model: AT/ET/UT/CT/UT- 3X1  
Warranty Duration: 2 Years  
Maximum Repair Time: 20 Days  
Serial Number:



#### Vendor Company

Title: .....  
Address: .....  
Telephone:..... Fax:.....  
E-Mail:.....  
Invoice Date and Number:.....  
Delivery Date and Place:.....  
Signature of Authorised Person:.....  
Company Stamp:.....

**STAMP**

#### Product's

Type: Gas Transmitter  
Brand: Ems Kontrol  
Model: AT/ET/UT/CT/UT- 3X1

Ems Kontrol reserves the right to make changes and improvements to the product specifications and user manual.

\*For all changes, please visit [emskontrol.com](http://emskontrol.com).